


Lampiran 2. Hasil uji kadar Carbon (C)

Larutan standart Carbon

Konsentrasi (ppm)	Absorbansi		Rata - rata
0	0,183		0,183
100	0,331	0,333	0,332
200	0,474	0,475	0,4745
300	0,494	0,502	0,498
400	0,605	0,606	0,6055
500	0,605	0,604	0,6045

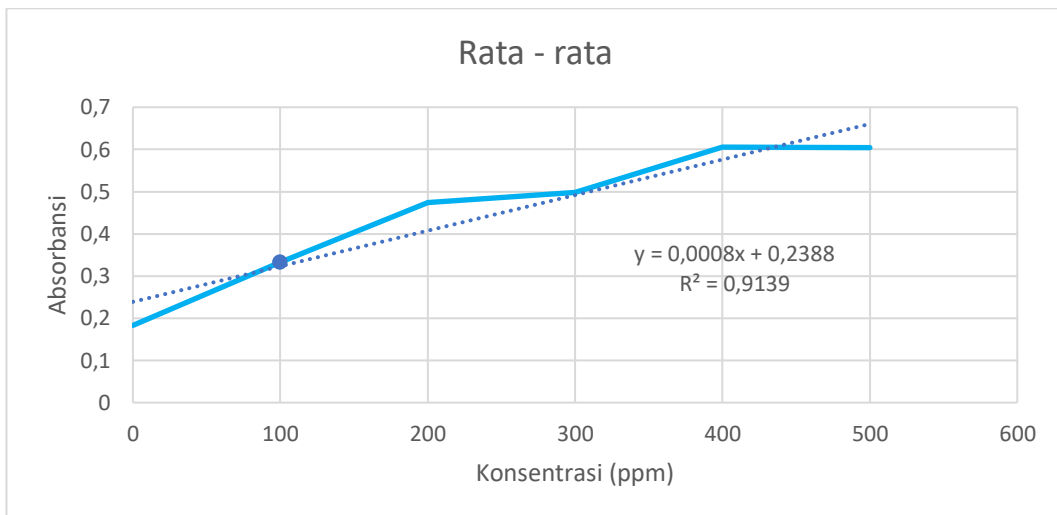

Sampel	Absorbansi	Konsentrasi (ppm)	Kadar karbon (%)
B1	0,35	139,000	15,44
B2	0,36	151,500	16,83
B3	0,36	151,500	16,83